



DATE REVISED	DATE FILMED	DATE REVISED	DATE FILMED	FED. ROAD DIST. NO.	STATE	FED. AID PROJ. NO.	SHEET NO.	TOTAL SHEETS
				6	ARK.			
							JOB NO.	
							TRANSITIONAL RAIL - 55013A	

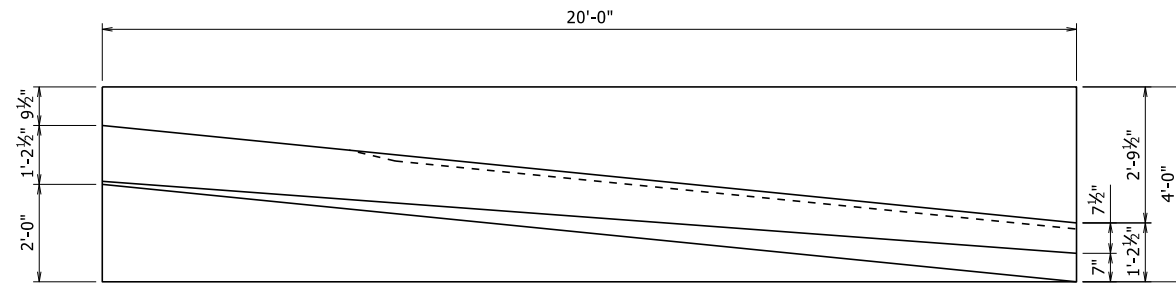

**PLAN OF TRANSITIONAL APPROACH RAILING**

Railings on each side of roadway are opposite hand to each other  
1/2" = 1'-0"

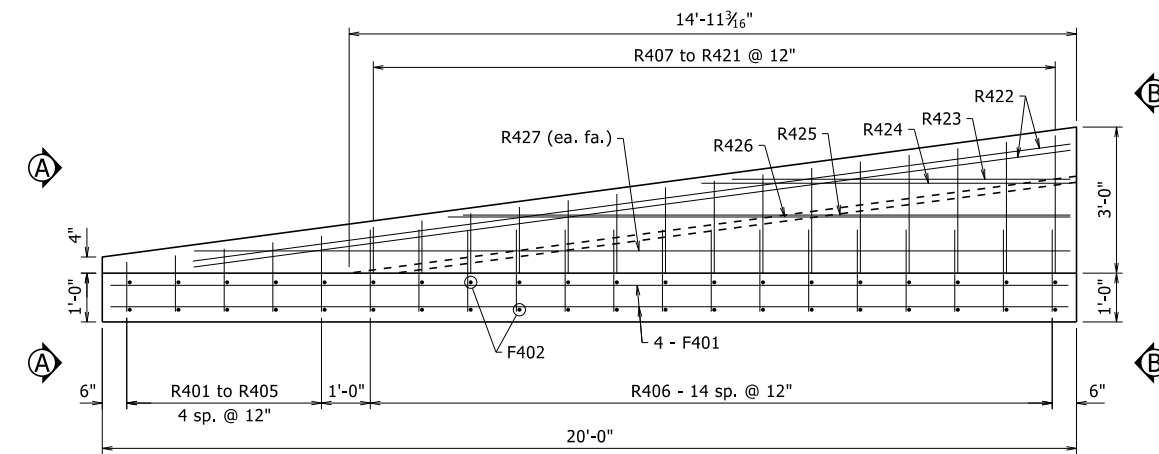

**ELEVATION OF TRANSITIONAL APPROACH RAILING**

1/2" = 1'-0"

**GENERAL NOTES**

Transitional Approach Railing Type SSTR36 shall be placed at locations shown in plans.

All concrete shall be Class "S" with a minimum 28 day compressive strength  $f'_c = 3,500$  psi and shall be poured in the dry. All exposed corners to be chamfered 1" unless otherwise noted.

All reinforcing steel shall be Grade 60 conforming to AASHTO M 31 or M 322, Type A, with mill test reports.

All longitudinal lines within the limits of horizontal curves shall be on curves concentric to C.L. Construction. Adjustment to longitudinal bar lengths may be required. Transverse reinforcing shall be placed on radial lines to C.L. Construction.

Unless otherwise required in the plans, curing and finishing shall be in accordance with Subsection 806.05(c) and the surface finish type and areas of application shall match that used on the adjacent bridge railing or barrier wall. See Subsection 802.19(3) for Class 3 Textured Coating Finish or Subsection 803.03(a) or 803.03(b) for Class 1 or 2 Protective Surface Treatment, respectively. Surface finishes shall not be paid for directly, but shall be considered incidental to the unit price bid for "Transitional Approach Railing."

When alternate surface and/or architectural finishes are specified in the plans, no direct payment will be made, and the alternate finish shall be considered incidental to the unit price bid for "Transitional Approach Railing". See plan details for additional information when architectural finishes are specified.

Transitional Approach Railing Type SSTR36 shall be paid for at the contract unit price bid for "Transitional Approach Railing". See Section 806 for additional information.

Scales shown are for 22"x34" drawings. When using 11"x17" drawings, reduce scale by one half.

**BAR LIST - ONE TRANSITIONAL APPROACH RAILING**


MARK	NO. REQ'D	LENGTH	P.D.	BENDING DIAGRAMS
F401	8	19'-8"	Str.	
F402	40	3'-8"	Str.	
R401 to R405	1 ea.	2'-10" - 3'-11"	2"	
R406	15	4'-5"	2"	
R407 to R421	1 ea.	2'-5" - 5'-9"	2"	
R422	2	18'-2"	Str.	
R423	1	6'-11"	Str.	
R424	1	7'-6"	Str.	
R425	1	12'-6"	Str.	
R426	1	12'-9"	Str.	
R427	2	17'-11"	Str.	

Dimensions are out to out of bars.

**FOR INFORMATION ONLY  
SCHEDULE OF QUANTITIES PER RAIL UNIT**

CLASS "S" CONCRETE	REINFORCING STEEL (GRADE 60)	CLASS 1 PROTECTIVE SURFACE TREATMENT	CLASS 2 PROTECTIVE SURFACE TREATMENT	CLASS 3 TEXTURED COATING FINISH
4.1 Cu. Yds.	374 Lbs.	0.2 Gal.	8.1 Sq. Yd.	15.6 Sq. Yd.

Only one of the above three surface treatments shall be applied to the transitional approach railing. See "General Notes" on this sheet.

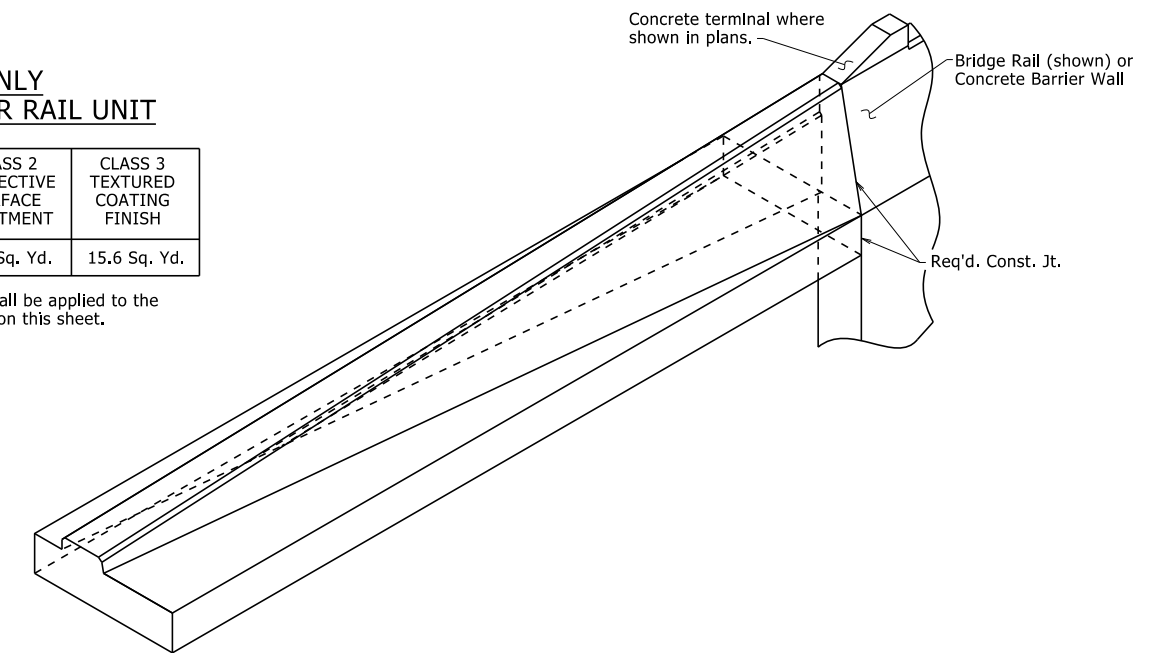

**PICTORIAL OF TRANSITIONAL APPROACH RAILING**

Sidewalk not shown for clarity  
No Scale

SECTION AND SUBSECTION REFER TO THE ARKANSAS STATE HIGHWAY AND TRANSPORTATION DEPARTMENT STANDARD SPECIFICATIONS FOR HIGHWAY CONSTRUCTION (2014 EDITION).

THESE DETAILS ARE APPLICABLE UNLESS OTHERWISE SHOWN IN THE PLAN DETAILS, SPECIAL PROVISIONS, OR SUPPLEMENTAL SPECIFICATIONS.

**STANDARD DETAILS FOR  
TRANSITIONAL APPROACH RAILING TYPE SSTR36**


**ARKANSAS STATE HIGHWAY COMMISSION**

LITTLE ROCK, ARK.


DRAWN BY: KWY DATE: 4/8/2021 FILENAME: b55013a.dgn  
CHECKED BY: BHS DATE: 4/8/2021 SCALE: As Shown  
DESIGNED BY: STD. DATE: --

DRAWING NO. 55013A

- ① Recess height varies as shown from 2'-0" to 0".
- ② Eliminate recess when formliner with architectural finish is used. See Plans for additional information.

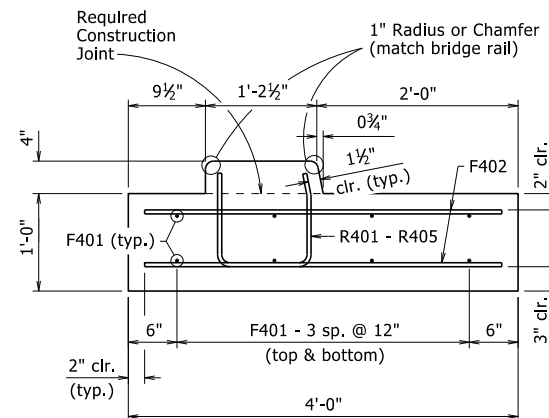

**VIEW A-A**  
1" = 1'-0"

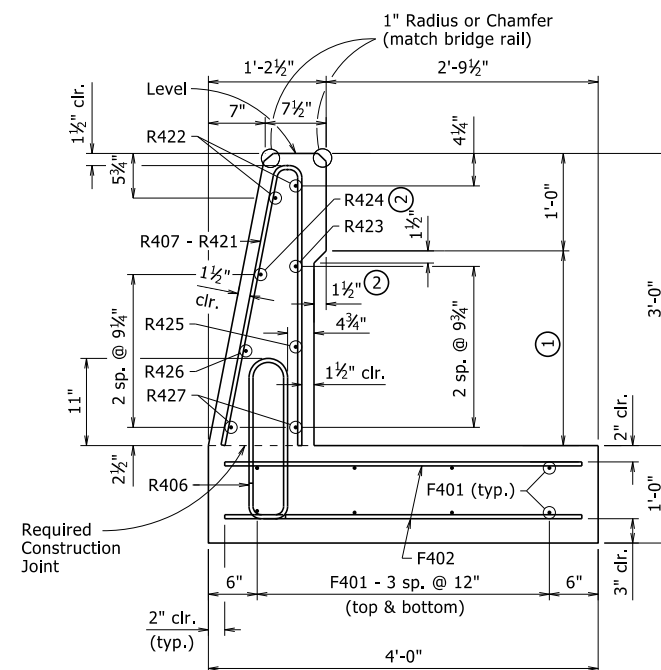

**VIEW B-B**  
1" = 1'-0"